

Company name: Created by: Phone:

28/04/2023

## On request UPS 40-50 FN 250 50 Hz H [m] eta [%] UPS 40-50 FN 250, 50Hz 5.5 5.0 4.5 4.0 3.5 3.0 2.5 2.0 1.5 1.0 0.5 0.0-0.5 1.0 1.5 2.0 2.5 3.0 3.5 4.0 4.5 5.0 5.5 6.0 6.5 7.0 7.5 8.0 Q [m³/h] o Pumped liquid = Water Liquid temperature during operation = 60 °C Density = 983.2 kg/m<sup>3</sup> P1 [W] 110 100 90 80 70 60 50 40 30 20 10.

0

-60

. 55

. 50

45

40

. 35

30

25

20

. 15

10


5

0



## Company name: Created by: Phone:

UPS 40-50 FN 250, 50Hz
$\times$ $\setminus$ $\setminus$
2 3 4 5 6 7 Q [m³/h]
= Water
ture during operation = 60 °C 2 kg/m³
100
67 121
<u>-</u>
1
1
1
1
I

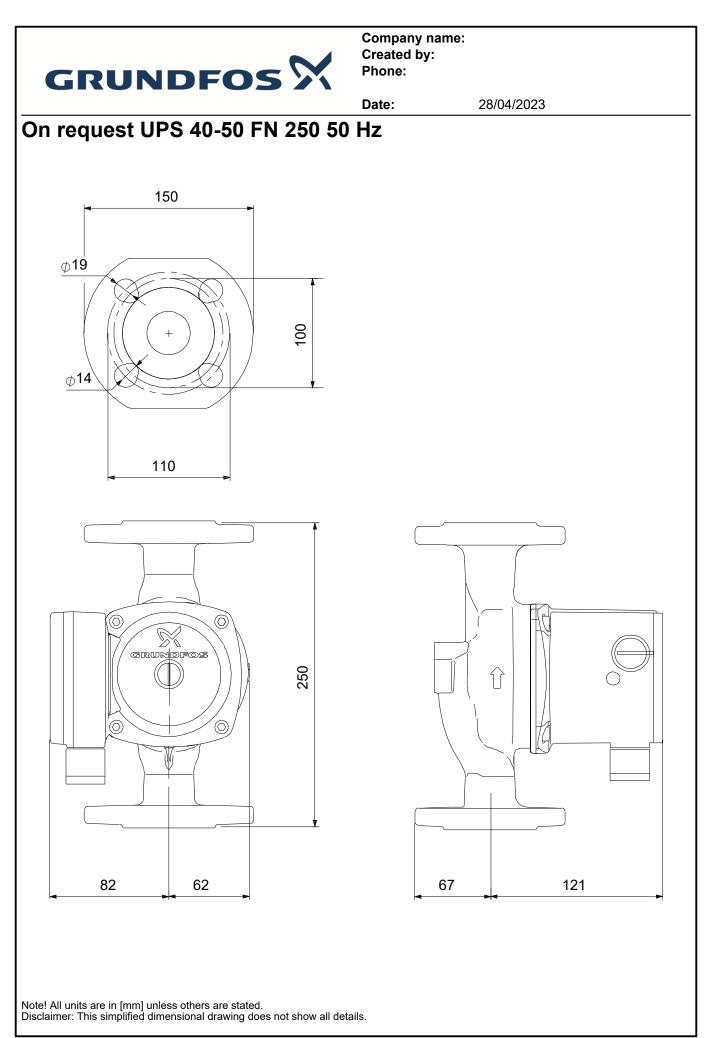




Company name: Created by: Phone:

28/04/2023

## On request UPS 40-50 FN 250 50 Hz

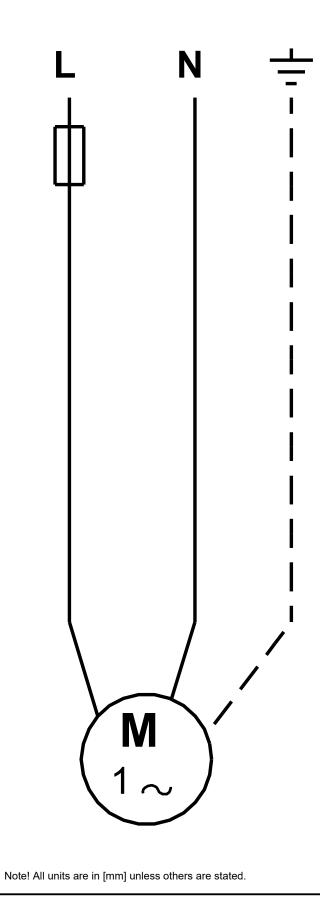



Position

Company name: Created by:

Phone: Date: 28/04/2023 **Order Data:** Your pos. **Product name** Amount **Product No** Total UPS 40-50 FN 250 1 On request Price on request